



Australian Government  
Department of Industry,  
Science and Resources

**National  
Measurement  
Institute**

36 Bradfield Road, West Lindfield NSW 2070

**Certificate of Approval  
NMI 14/2/113**

Issued by the Chief Metrologist under Regulation 60  
of the  
*National Measurement Regulations 1999*

This is to certify that an approval for use for trade has been granted in respect of the instruments herein described.

CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE Electricity Meter

submitted by           CET Electric Technology Inc.  
8/F West Side, Building 201  
Terra Industrial & Trade Park, Che Gong Miao  
Shenzhen  
Guang Dong  
P.R.China - 518040

**NOTE:** This Certificate relates to the suitability of the pattern of the instrument for use for trade only in respect of its metrological characteristics. This Certificate does not constitute or imply any guarantee of compliance by the manufacturer or any other person with any requirements regarding safety.

This approval has been granted with reference to NMI M 6-1 *Active-Energy Electricity Meters. Part 1: Metrological and Technical Requirements*, June 2022.

This approval is subject to review at the decision of the Chief Metrologist in accordance with the conditions specified in the document NMI P 106.

**DOCUMENT HISTORY**

<b>Rev</b>	<b>Reason/Details</b>	<b>Date</b>
0	Pattern and Variants 1, 2 & 3 approved – certificate issued	27/06/23
1	Pattern and variants amended – Corrections to submittor, features/functions and figures 3 to 6 – certificate issued	20/07/23


## CONDITIONS OF APPROVAL

### General

Instruments purporting to comply with this approval shall be marked with approval number 'NMI 14/2/113' and only by persons authorised by the submitter.

It is the submitter's responsibility to ensure that all instruments marked with this approval number are constructed as described in the documentation lodged with the National Measurement Institute (NMI) and with the relevant Certificate of Approval and Technical Schedule. Failure to comply with this Condition may attract penalties under Section 19B of the National Measurement Act and may result in cancellation or withdrawal of the approval, in accordance with document NMI P 106.

Signed by a person authorised by the Chief Metrologist  
to exercise their powers under Regulation 60 of the  
*National Measurement Regulations 1999.*

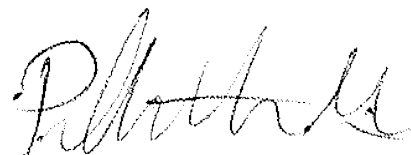A handwritten signature in black ink, appearing to read 'Phillip Mitchell', is positioned above the printed name and title.

**Phillip Mitchell**  
Acting Manager  
Policy and Regulatory Services

TECHNICAL SCHEDULE No 14/2/113

**1. Description of Pattern**

**approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE poly phase class 1 direct connected static watt hour meter (Figure 1) used to measure electrical energy.

**1.1 Field of Operation**

The field of operation of the measuring system is determined by the following characteristics:

- Number of phases 3
- Number of wires 4
- Reference frequency 50 Hz
- Reference ambient temperature ranges:
  - specified range of operation -25 to 70 °C
  - limit range of operation -25 to 70 °C
- Rated voltage 230 V AC
- Rated currents: Basic current,  $I_b$  20 A  
Maximum current,  $I_{max}$  100 A
- Meter constant 100 imp/kWh
- Accuracy class 1

**1.2 Features/Functions**

- Liquid crystal digital indicator having a maximum display of 9,999,999.99 kWh
- DIN-rail mounting
- Crystal controlled internal clock
- Communications via Modbus RTU
- Measurement in both positive and negative directions

**1.3 Verification Provision**

Provision is made for the application of a verification mark.

**1.4 Sealing Provision**

Solid State Sealing only (Figure 1).

## 1.5 Descriptive Markings

Instruments are marked with the following data, together in one location:

Manufacturer's mark, or name written in full	.....
Model designation	.....
Serial number	.....
Pattern approval mark	NMI 14/2/113
Number of phases	.....
Number of wires	.....
Reference frequency	..... Hz
Temperature limits (if other than -10 to 60°C)	... to ... °C
Meter constant	.....
Rated voltage	..... AC
Rated currents:	$I_b$ ..... A
	$I_{max}$ ..... A
Accuracy class	...

## 1.6 Harmonics

Instruments purporting to comply with this approval are suitable for use where the harmonics do not exceed those specified in NMI M 6-1:2022.

## 2. Description of Variant 1

**approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BB35XAE poly phase class 0.5 CT connected static watt hour meter (Figure 2) used to measure electrical energy.

The variant has the same Field of Operation and Features and Functions as the pattern except for the following:

- Rated currents: Rated current,  $I_n$  5 A  
Maximum current,  $I_{max}$  6 A
- Meter constant 1000 imp/kWh
- Accuracy class 0.5

## 3. Description of Variant 2

**approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE poly phase class 1 direct connected static watt hour meter (the pattern) used to measure electrical energy.

The variant has the same Field of Operation as the pattern except for the following:

- Meter constant 100 imp/kWh or 500 imp/kWh

The variant has the same Features and Functions as the pattern except for the following:

- Firmware version V.1.00.03
- Additional meter constant is user configurable using menu system on LCD screen (Figure 3).

Note: Only meters with the updated Firmware version to be used for selecting additional meter constant.

#### **4. Description of Variant 3** **approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BB35XAE poly phase class 0.5 CT connected static watt hour meter (variant 1) used to measure electrical energy.

The variant has the same Field of Operation as variant 1 except for the following:

- Meter constant 1000 imp/kWh, 3200 imp/kWh or 5000 imp/kWh

The variant has the same Features and Functions as variant 1 except for the following:

- Firmware version V.1.00.03
- Additional meter constant is user configurable using menu system on LCD screen (Figure 4).

Note: Only meters with the updated Firmware version to be used for selecting additional meter constant.

#### **5. Description of Variant 4** **approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE poly phase class 1 direct connected static watt hour meter (the pattern and variant 2) used to measure electrical energy, also known as IPD3100C with appropriate markings (Figure 5).

#### **6. Description of Variant 5** **approved on 27/06/23**

A CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BB35XAE poly phase class 0.5 CT connected static watt hour meter (variant 1 and variant 3) used to measure electrical energy, also known as IPD3005C with appropriate markings (Figure 6).

### TEST PROCEDURE No 14/2/113

Instruments tested for initial verification shall comply with the certificate of approval and technical schedule, and the maximum permissible errors for verifications at the operating conditions in effect at the time of verification.


The maximum permissible errors are specified in the *National Trade Measurement Regulations 2009* (Cth).

Meters shall be verified in accordance with NITP 14 *National Instrument Test Procedures for Utility Meters*.

Evidence of verification shall be confirmed via the meter serial number and certificate of verification issued by a utility meter verifier in accordance with NITP 14.


NOTE: NMI reserves the right to vary this procedure. Any such variation shall be notified in writing by NMI.

FIGURE 14/2/113 – 1

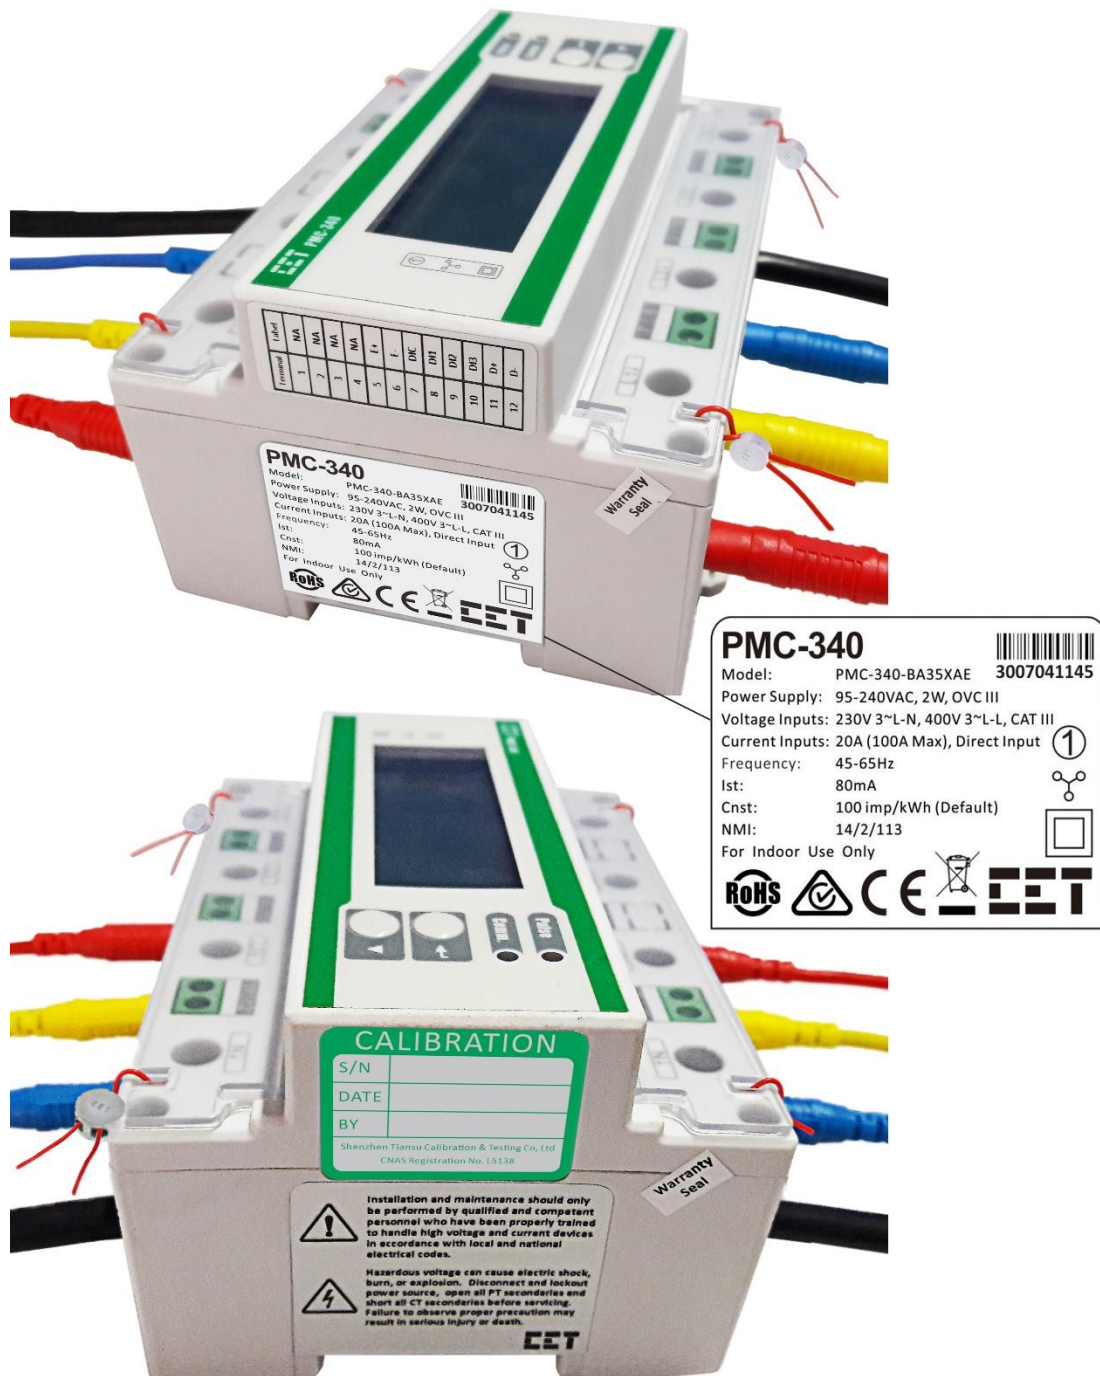


CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE Class 1  
Direct connected Electricity Meter showing markings

FIGURE 14/2/113 – 2

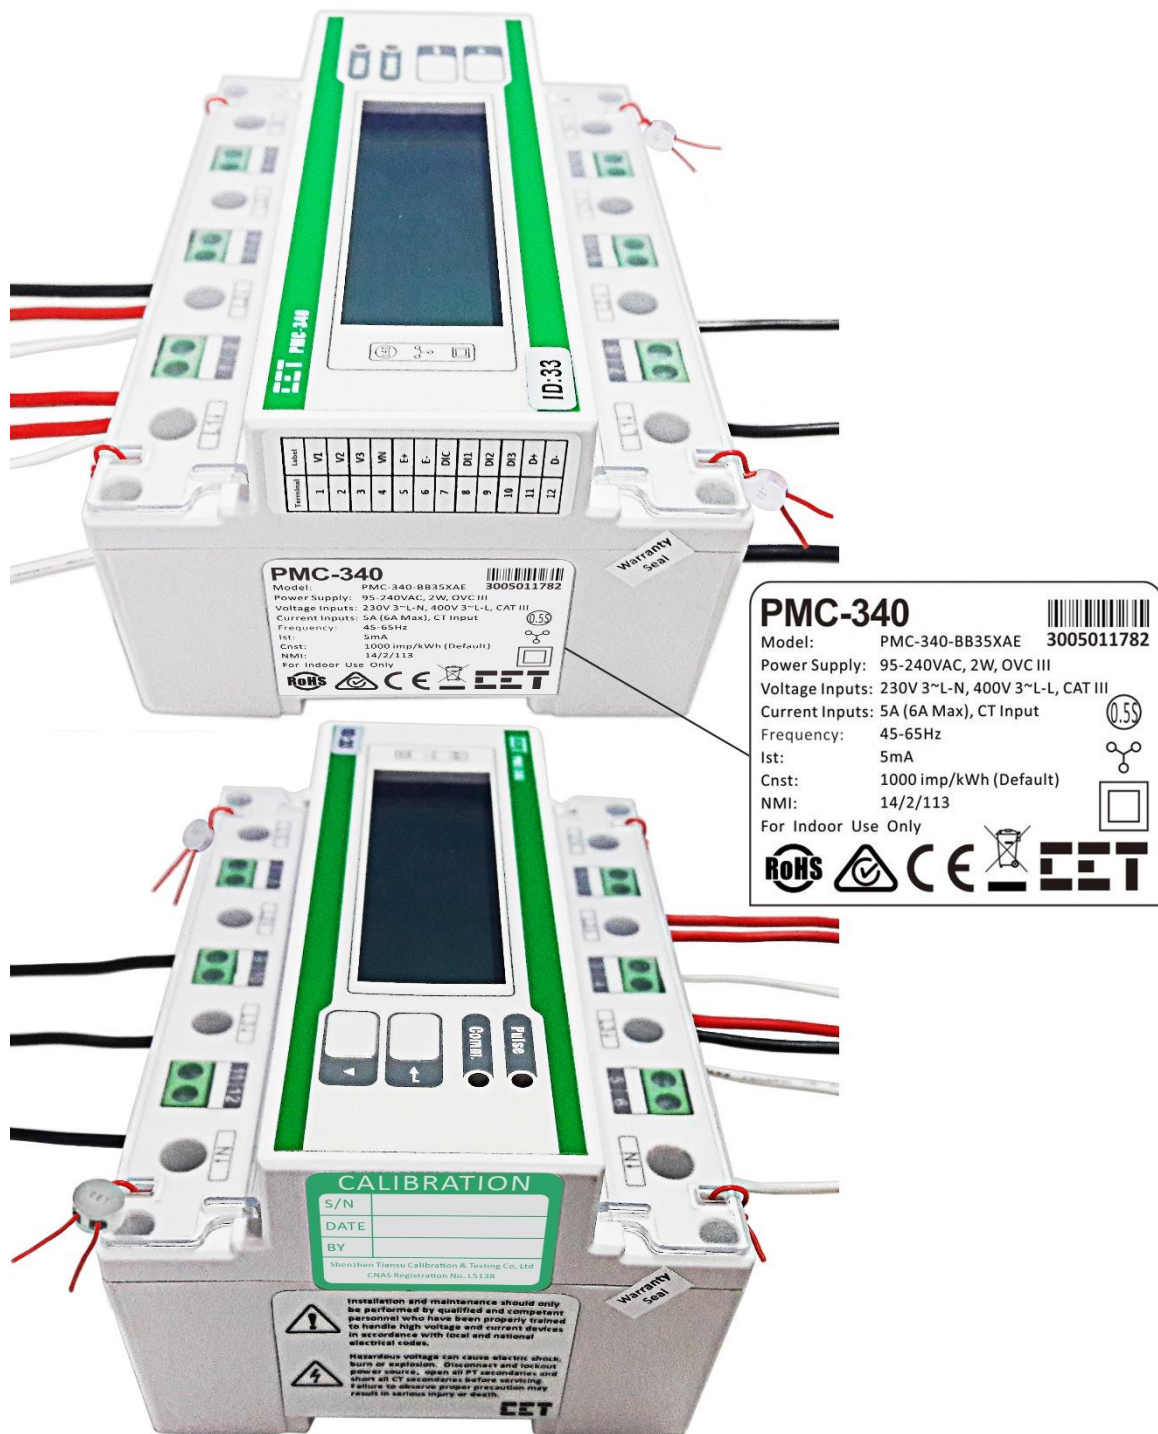

CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BB35XAE Class 0.5 CT connected Electricity Meter showing markings


FIGURE 14/2/113 – 3

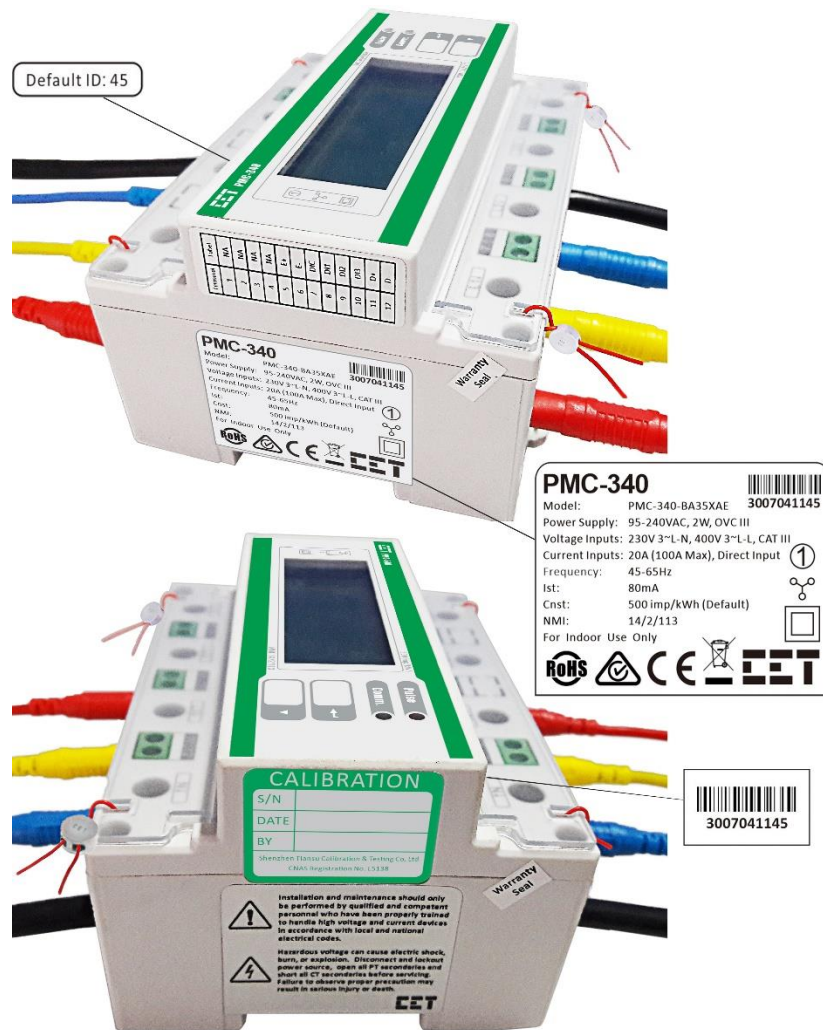

CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BA35XAE Class 1  
Direct connected Electricity Meter (variant 2) with user configurable meter constants




FIGURE 14/2/113 – 4

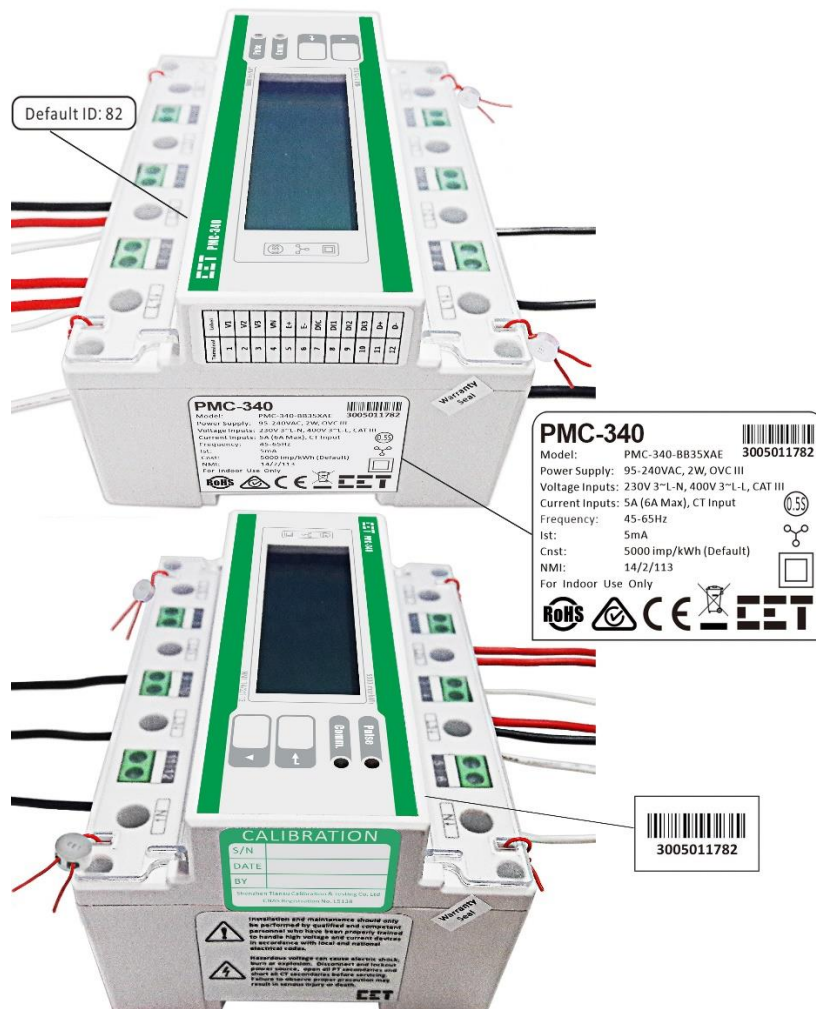


CET ELECTRIC TECHNOLOGY INC. model CET PMC-340-BB35XAE Class 0.5 CT connected Electricity Meter (variant 3) with user configurable additional meter constants

FIGURE 14/2/113 – 5

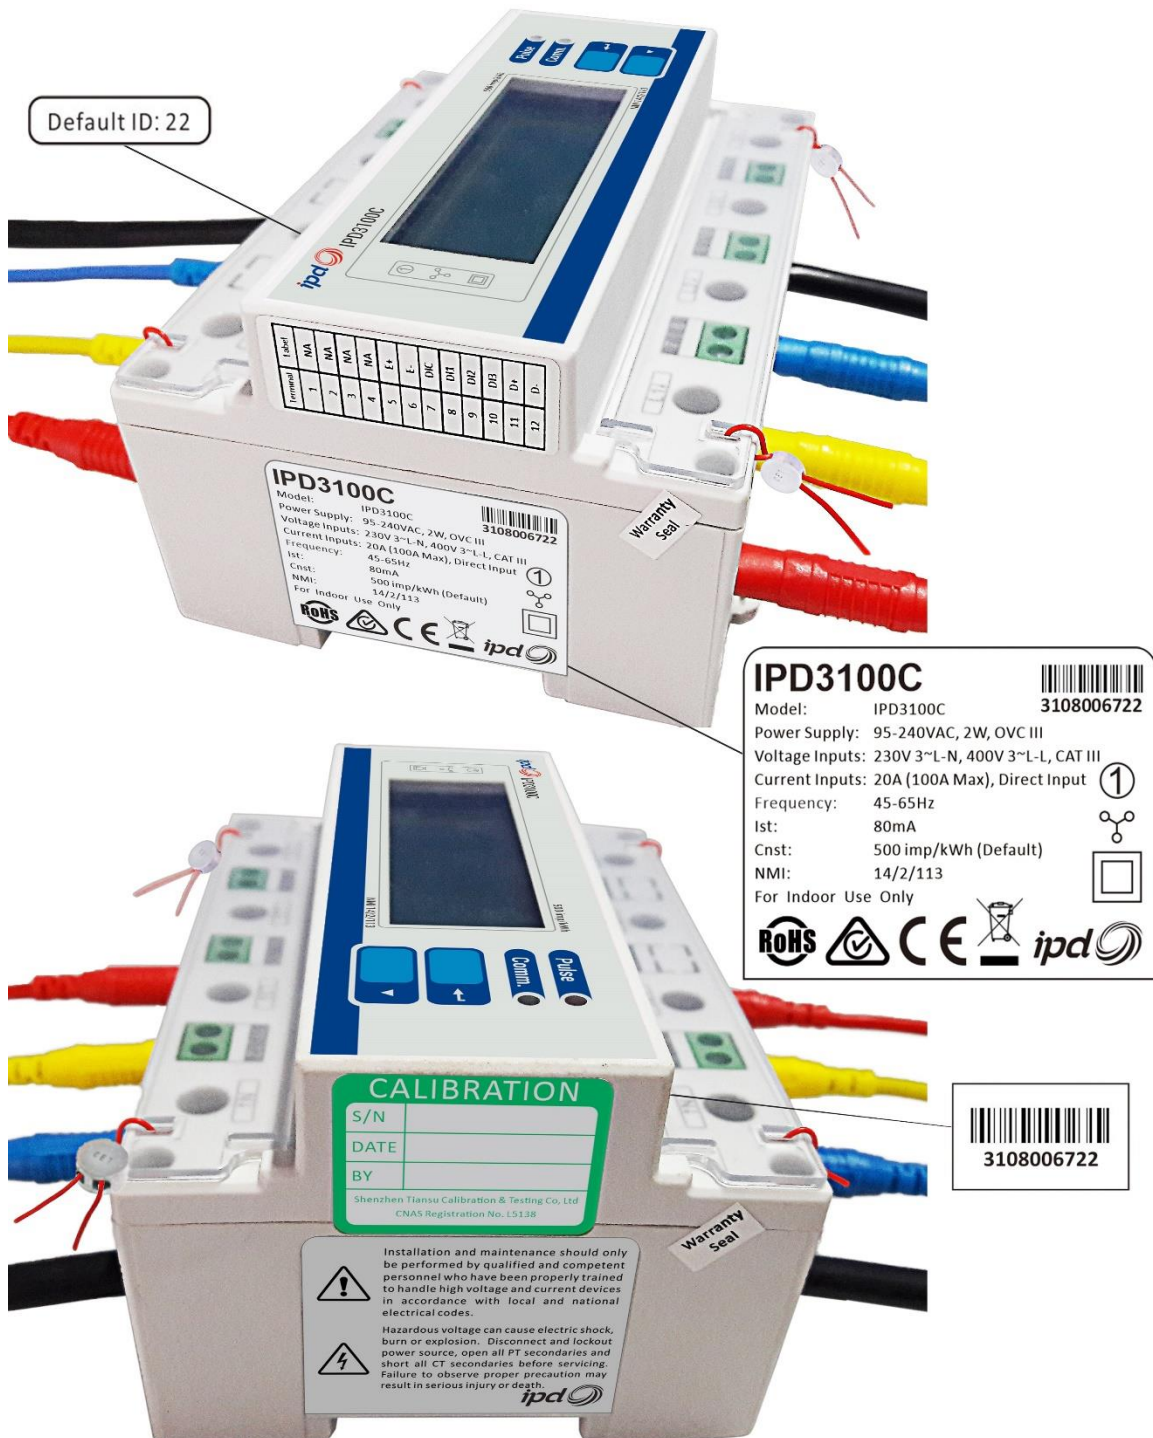

CET ELECTRIC TECHNOLOGY INC. model IPD 3100C Class 1 Direct connected Electricity Meter (variant 4) showing markings

FIGURE 14/2/113 – 6

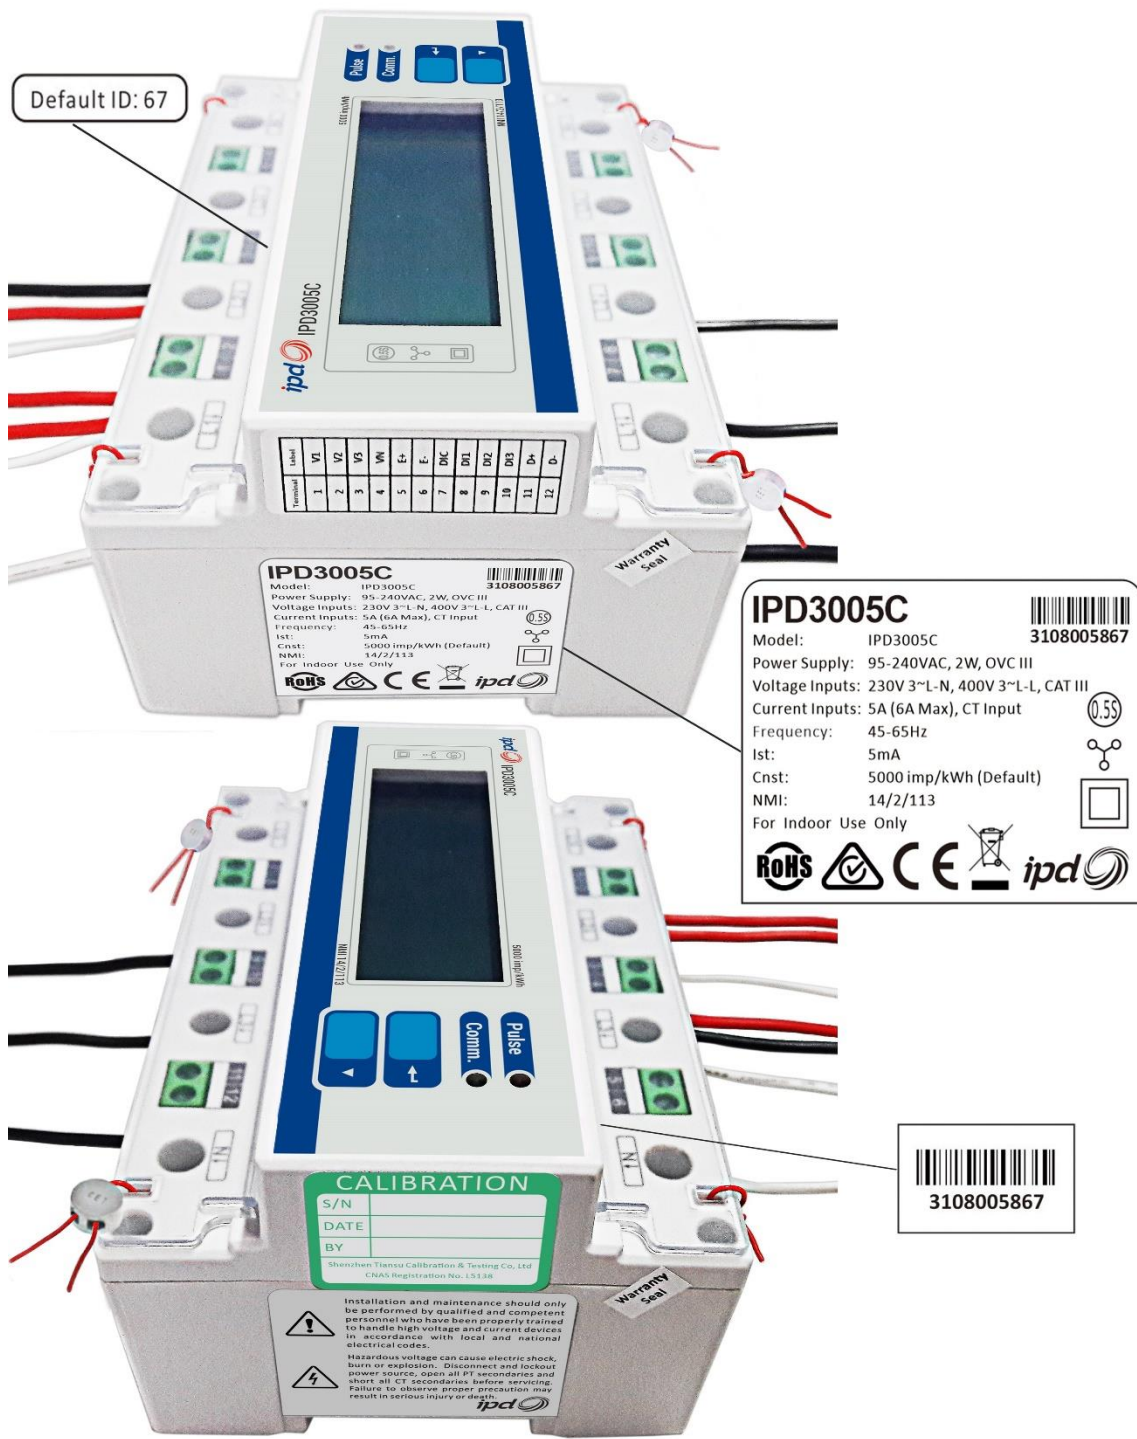

CET ELECTRIC TECHNOLOGY INC. model IPD 3005C Class 0.5 CT connected Electricity Meter (variant 5) showing markings

~ End of Document ~