

# National Measurement Institute

36 Bradfield Road, West Lindfield NSW 2070

# Interim Provisional Certificate of Approval NMI P14/3/41A

#### **VALID FOR VERIFICATION PURPOSES UNTIL 1 JULY 2024**

Issued by the Chief Metrologist under Regulation 60 of the
National Measurement Regulations 1999

This is to certify that an approval for use for trade has been granted in respect of the instruments herein described.

Sanchuan W350 Series Ultrasonic Water Meter

submitted by Sanchuan Wisdom Technology Co., Ltd.

Sanchuan Hydraulic Industrial Park, Longgang Section

Hi-Tech Development Zone

Yingtan

Jiangxi 335000

**CHINA** 

**NOTE:** This Certificate relates to the suitability of the pattern of the instrument for use for trade only in respect of its metrological characteristics. This Certificate does not constitute or imply any guarantee of compliance by the manufacturer or any other person with any requirements regarding safety.

This approval has been granted with reference to document NMI R 49-1 Water meters for cold potable water and hot water, Part 1 Metrological and technical requirements, dated May 2022.

This approval is subject to review at the decision of the Chief Metrologist in accordance with the conditions specified in the document NMI P 106.

#### DOCUMENT HISTORY

Rev	Reason/Details	Date
0	Pattern & Variants 1 to 4 provisionally approved – certificate	31/10/23
	issued	
1	Special conditions amended (number of meters) – certificate	31/01/24
	issued	

#### CONDITIONS OF APPROVAL

#### General

Instruments purporting to comply with this approval shall be marked with pattern approval number 'NMI 14/3/41A' and only by persons authorised by the submittor.

It is the submittor's responsibility to ensure that all instruments marked with this approval number are constructed as described in the documentation lodged with the National Measurement Institute (NMI) and with the relevant Certificate of Approval and Technical Schedule. Failure to comply with this Condition may attract penalties under Section 19B of the National Measurement Act and may result in cancellation or withdrawal of the approval, in accordance with document NMI P 106.

## Special Conditions of Provisional Approval – amended 31/01/24

The approval will remain provisional pending completion of required testing and evaluation. In the event of unsatisfactory performance of the meter or non-compliance with the special conditions, the provisional approval may be amended, cancelled or withdrawn.

The submittor shall implement such modifications as required by the Chief Metrologist. In the event that such modifications (if any are required) are not made to the satisfaction of the Chief Metrologist, the provisional approval may be cancelled or withdrawn.

The submittor shall provide the Chief Metrologist with copies of all required test results and additional information within 6 (six) months of the issue date of this Certificate.

The provisional approval is limited to 10,000 meters only.

Signed by a person authorised by the Chief Metrologist to exercise their powers under Regulation 60 of the *National Measurement Regulations* 1999.

Darryl Hines Manager

Policy and Regulatory Services

#### TECHNICAL SCHEDULE No P14/3/41A

#### 1. Description of Pattern

#### approved on 31/10/23

A Sanchuan W350 Series Ultrasonic Water Meter (Figure 1) used to measure cold potable water for supply for trade.

The model number shall have the form: W351xxxxxxxxxxxx (where x may be any alphanumeric identifier corresponding to the hardware configurations of the meter).

### 1.1 Field of Operation

The field of operation of the measuring system using the Sanchuan DN20 Ultrasonic water meter is determined by the following characteristics:

Minimum flow rate,  $Q_1$  0.01 m<sup>3</sup>/h

Transition flow rate, Q<sub>2</sub> 0.016 m<sup>3</sup>/h

Maximum continuous flow rate, Q<sub>3</sub>: 4.0 m<sup>3</sup>/h

Overload flow rate, Q<sub>4</sub> 5.0 m<sup>3</sup>/h

Flow rate ratio,  $Q_3/Q_1$ : 400

Temperature class: T50

Maximum admissible temperature: 50 °C

Maximum admissible pressure: 1600 kPa

Pressure loss class: Δp 40

Accuracy class: 2

Flow profile sensitivity class: U0/D0 – see clause 1.3

Electromagnetic class: E1 (residential, commercial, light industrial)

Environmental class: B & O (indoor and outdoor)

Orientation: All positions

Flow Direction: Forward only

Power supply: Non-replaceable battery (3.0-3.6 V)

#### 1.2 Features/Functions

The pattern consists of an ultrasonic flow sensor and an indicating flow converter (calculator/indicator) and has features/functions as listed below:

Connection type: Threaded end connections type standard R3/4 G1

Display: A digital, electronic, liquid crystal display allowing for a

maximum indication range of 9,999,999.9999 m<sup>3</sup> in 0.0001 m<sup>3</sup>

increments

Communications<sup>(1)</sup>: Optical output

Materials: Flow tube: Brass

Meter casing: Polymer material

Meter length: 154 mm

Non-return device: Check valves

(1) The pattern and variants may be fitted and/or configured with the communication options listed in this Certificate. However, the primary indication of volume displayed by the indicating device of the meter is the approved indication of volume.

#### 1.3 Conditions

#### 1.3.1 Installation Conditions:

No flow straightener or flow conditioner is required.

The flow profile class is U0/D0 (Accuracy Class 2).

An optional strainer may be fitted.

#### 1.4 Water Quality

The meter is approved for use in the metering of potable water supplies.

#### 1.5 Firmware

The pattern is approved for use with firmware version V5738.03.

#### 1.6 Verification Provision

Provision is made for the application of a verification mark.

## 1.7 Sealing Provision

The meter is mechanically sealed via the snap-fitting of the upper and lower sections of the meter casing, such that attempts to mechanically access the meter will result in evidence of tampering. Additional mechanical seal may be applied (Figure 2). Electronic access to meter functions and parameters may be locked to prevent unauthorised access. Certain parameters shall remain protected and are only configurable by the supplier.

## 1.8 Descriptive Markings

Instruments are marked with the following data, either grouped or distributed on the casing, the indicating device dial or an identification plate (Figures 3 and 4):

Manufacturer's name or mark Sanchuan

Serial number ...

Pattern approval number NMI 14/3/41A

Numerical value of maximum continuous flow rate,  $Q_3$  ... Flow rate ratio,  $Q_3/Q_1$  ... Unit of measurement  $m^3$ 

Maximum admissible pressure (1) 1600 kPa

Maximum pressure loss <sup>(2)</sup> 40 kPa or Δp 40

Temperature class <sup>(3)</sup>
Orientation <sup>(4)</sup>
Flow profile sensitive class <sup>(5)</sup>

T50

...

U0/D0

Direction of flow  $\rightarrow$  or similar

Accuracy class <sup>(6)</sup>

(1) Optional for meters with MAP = 1400 kPa

(2) Optional for class Δp63

(3) Optional for T30 meters

(4) Optional for meters approved for all orientations

(5) Optional for U0/D0 class meters

(6) Optional for class 2 meters

For instruments that incorporate electronic devices, the following information can either be physically marked on the instrument or provided electronically via the indicating device or similar means:

Electromagnetic class E1

Environmental class B or O

For meters with an external power supply the voltage and frequency

For battery powered meters a replacement date or similar

indication of expected battery life

# 2. Description of Variant 1

# approved on 31/10/23

The Sanchuan W350 Series DN20 sized Ultrasonic Water Meter is approved with the flowrates and technical characteristics as listed below in Table 1. The Pattern is included in **bold** for completeness.

Table 1 - Flowrates and technical characteristics for DN20

Meter size	DN20	DN20	DN20
Minimum flowrate Q <sub>1</sub> (m <sup>3</sup> /h)	0.01	0.013	0.016
Transitional flowrate Q <sub>2</sub> (m <sup>3</sup> /h)	0.016	0.02	0.0256
Maximum continuous flowrate Q <sub>3</sub> (m <sup>3</sup> /h)	4.0		
Overload flowrate Q <sub>4</sub> (m <sup>3</sup> /h)	5.0		
Ratio Q <sub>3</sub> /Q <sub>1</sub>	400	315	250
Meter Length (mm)	154		
Maximum Admissible Pressure (kPa)	<b>1600</b> or 1400		
Pressure loss class	<b>Δp 63</b> or Δp 40		
Verification scale interval (m³)	0.0001		

## 3. Description of Variant 2

## approved on 31/10/23

A Sanchuan W350 Series DN25 sized Ultrasonic Water Meter (Figure 5) with the flowrates and technical characteristics as listed below in Table 2.

Table 2 – Flowrates and technical Characteristics for DN25

Meter size	DN25	DN25	DN25	
Minimum flowrate Q <sub>1</sub> (m <sup>3</sup> /h)	0.01575	0.02	0.0252	
Transitional flowrate Q <sub>2</sub> (m <sup>3</sup> /h)	0.0252	0.032	0.04	
Maximum continuous flowrate Q <sub>3</sub> (m <sup>3</sup> /h)	6.3			
Overload flowrate Q <sub>4</sub> (m <sup>3</sup> /h)	7.875			
Ratio Q <sub>3</sub> /Q <sub>1</sub>	400	315	250	
Meter Length (mm)	178			
Maximum Admissible Pressure (kPa)	1600 or 1400			
Pressure loss class	Δp 63 or Δp 40			
Verification scale interval (m³)	0.0001			

## 4. Description of Variant 3

approved on 31/10/23

The Pattern and Variants may be marked with the alternative branding of Landis+Gyr instead of Sanchuan (Figures 6 and 7).

#### 5. Description of Variant 4

approved on 31/10/23

The Pattern and Variants are approved with the alternative firmware versions specified in Table 3. Firmware version information is available in the selectable menus accessible via the meter display.

**Table 3 – Approved Firmware Versions** 

Version Number	Notes
V5708.9	Previous base firmware version
V12700.09	New metrology firmware
V5734.02	Supports additional security features
V5735.05	Supports communications improvements
V5738.03	Approved with pattern

#### TEST PROCEDURE No P14/3/41A


Water meters tested for verification shall comply with the Certificate of Approval, Technical Schedule, and the maximum permissible errors for verification at the operating conditions in effect at the time of verification. Maximum permissible errors for the verification of water meters are given in the *National Trade Measurement Regulations 2009* (Cth).

Water meters shall be verified in accordance with NITP 14 *National Instrument Test Procedures for Utility Meters*.


NOTE: NMI reserves the right to vary this procedure. Any such variation shall be notified in writing by NMI.



Sanchuan DN20 Ultrasonic water meter – (the Pattern)

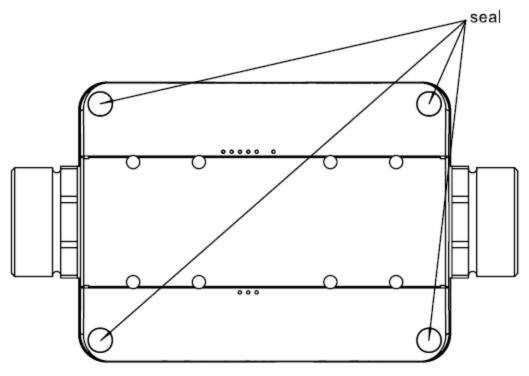


Sanchuan W350 Series Ultrasonic Water Meter – Sealing

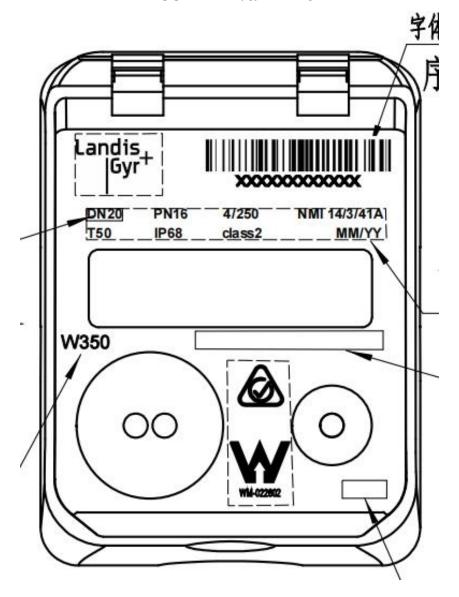

Sanchuan W350 Series Ultrasonic Water Meter – Example Markings




Sanchuan W350 Series Ultrasonic Water Meter - Direction of flow marking

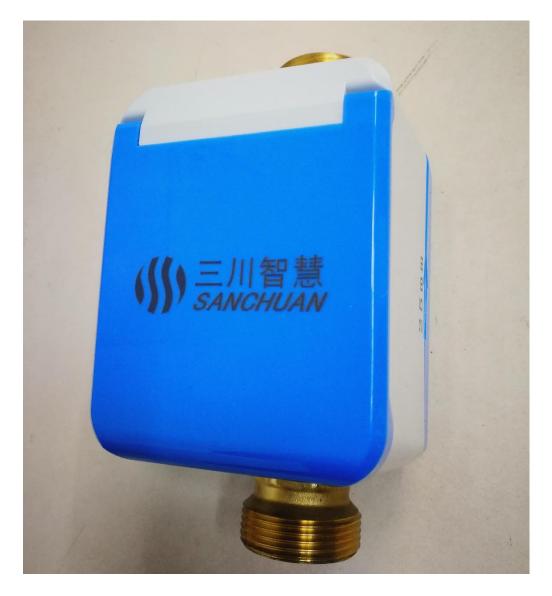

Sanchuan W350 Series DN25 Ultrasonic Water Meter – (Variant 2)



Alternative branding – Landis+Gyr (Variant 3)

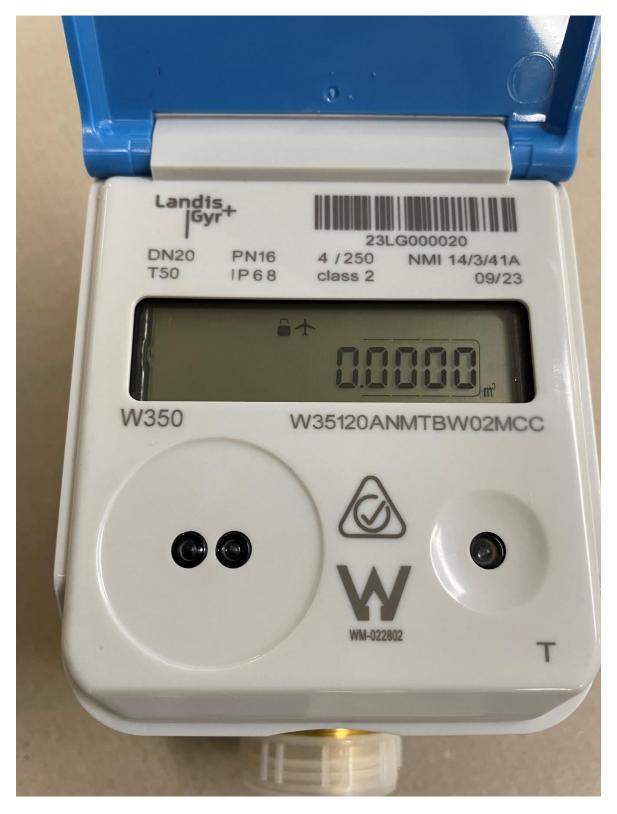

Alternative branding – Landis+Gyr (Variant 3)

~ End of Document ~