



Weights and Measures  
(National Standards)  
Act 1960-1964

Weights and Measures  
(Patterns of Instruments)  
Regulations

COMMONWEALTH OF AUSTRALIA

NATIONAL STANDARDS COMMISSION

# *Certificate of Approval*

---

CERTIFICATE NUMBER 5/6A/31

*In respect of the pattern of*

Wayne Blending Pump Model 605

Submitted by: Wayne Pumps Australia Pty. Ltd. ,  
29 Anzac Highway,  
Keswick,  
South Australia. 5035.

This is to certify that the pattern of the instrument illustrated and described in this Certificate has been examined by the National Standards Commission under the provisions of No 12 of the abovementioned Regulations and has been approved as being suitable for use for trade.

Approval was granted on 6th August, 1969.

Approval was granted on condition that all instruments made in conformity with the pattern:

1. are appropriately marked NSC No 5/6A/31 and, where required by State legislation, with the State approval number also; and
2. comply with the General Specifications for Weighing and Measuring Instruments to be Used for Trade in

6/8/69

Cont'd over


respect of that part of the instrument which was not previously approved by a State.

This Certificate comprises:

Pages 1 and 2 dated 6th August, 1969.

Figure 5/6A/31 - 1 dated 6th August, 1969.

This Certificate is applicable in all States except Queensland.

Signed 


Date of issue 6th August, 1969.

### DESCRIPTION

The pattern (see Figure 1) is a modification of a retail price-computing blending flowmeter, approved in all States except Queensland. The modification consists of fitting a Wayne P9520 meter, as described in Certificate No 5/6A/28.

The instrument is approved for liquid petroleum of viscosity not more than 1 cSt, the nameplate being marked "approved for petroleum  $\leq$  1 cSt".

FIGURE 5/6A/31 - 1

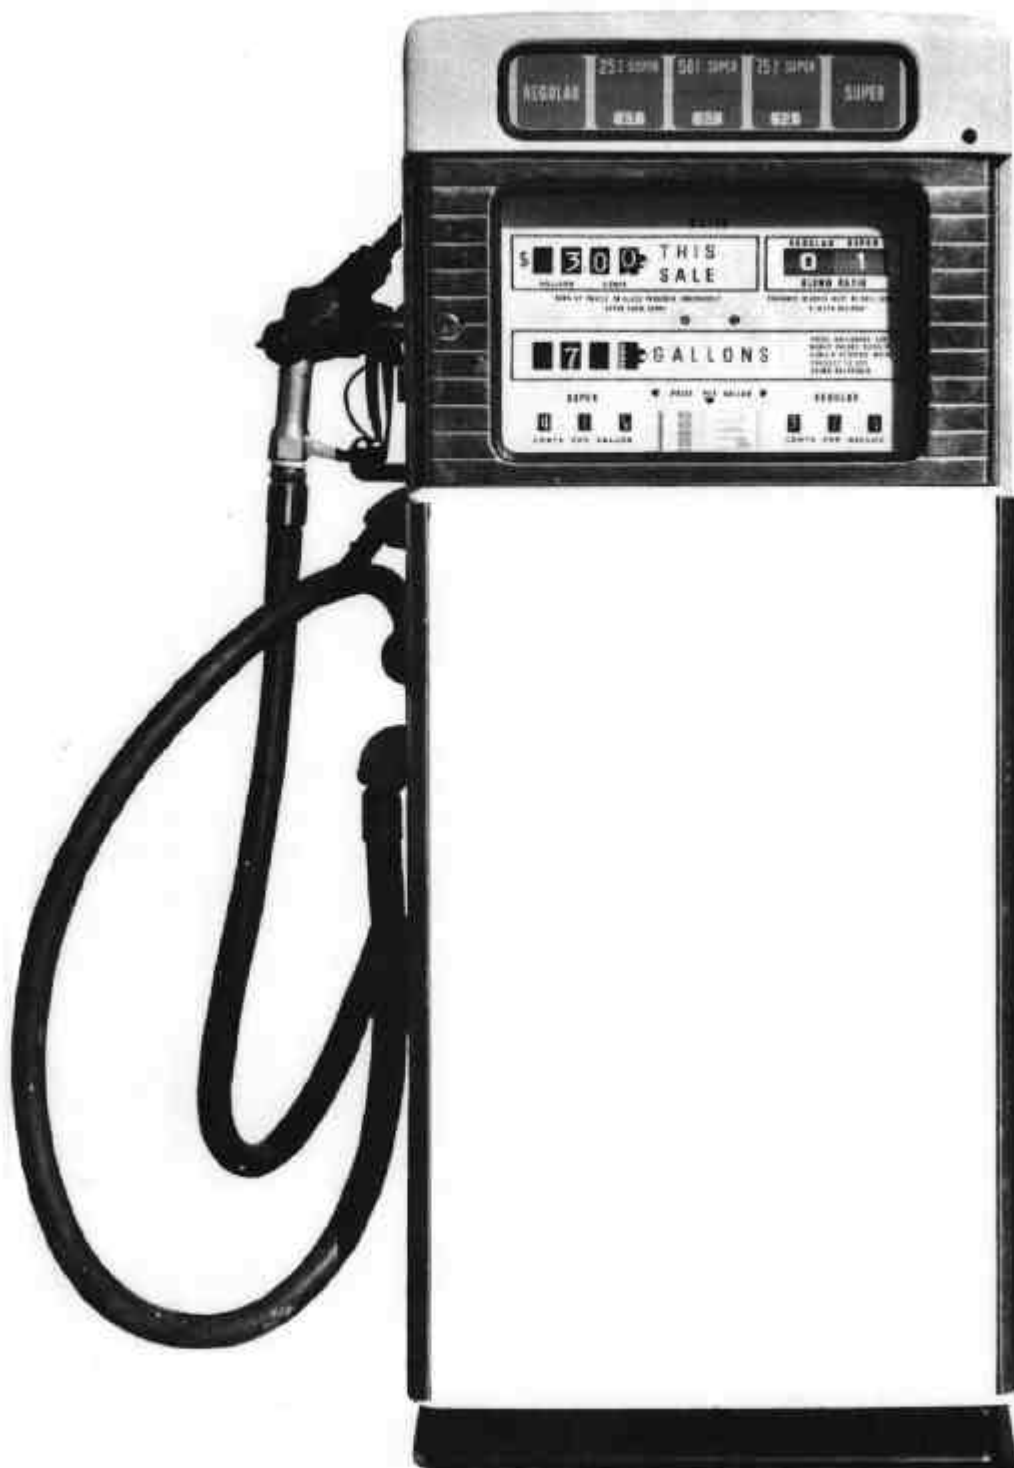

Wayne Blending Pump Model 605

6/8/69